Market Values of Variable Renewable Energy:

Energy and Capacity Value

Dung-Bai (Tony) Yen


Msc. Renewable Energy Engineering and Management,

University of Freiburg

Nomenclature

- ≻MEV = Marginal Energy Value
- >MC = Marginal Cost
- >CPP = Conventional Power Plants
- >RL = Residual Load
- ≻CF = Capacity Factor
- ≻DL = Demand Load
- ≻Cap = Installed Capacity
- ≻AEV = Average Energy Value
- ≻t* : Time of peak RL occurrence

- MCV = Marginal Capacity Value
- >ACV = Average Capacity Value
- ≻VRE = Variable Renewables
- >DLDC = DL Duration Curve
- >RLDC = RL Duration Curve
- ▶_i : Technology type / retailer i
- P = Power
- CAPEX = Capacity Expenditure
- ➤(M)RO = (Marginal) Reserve Obligation

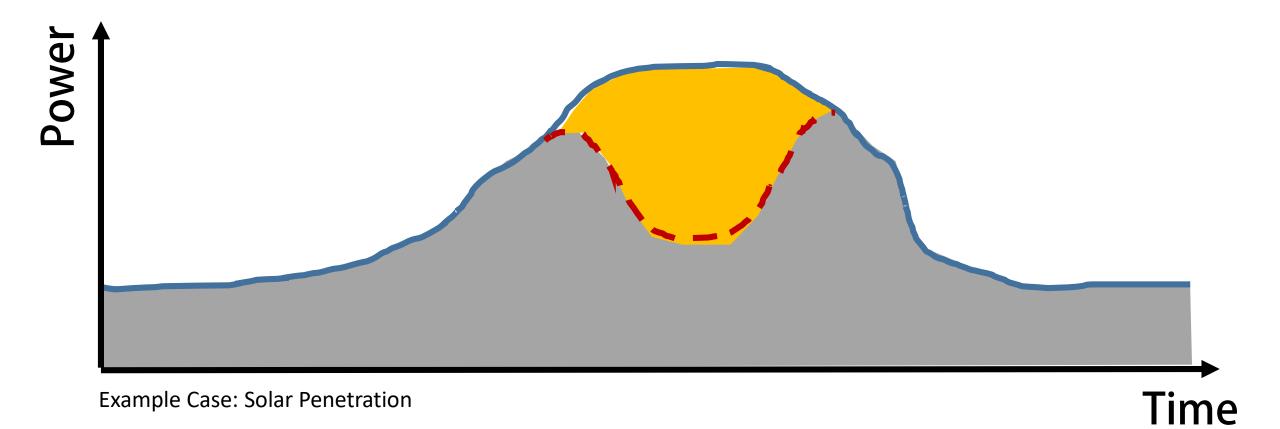



Time

MEV per Capacity: $\int MC_{CPP}(RL(t)) \cdot CF(t)dt$ RL(t): $DL(t) - Cap \cdot CF(t)$


Example Case: Solar Penetration


Power

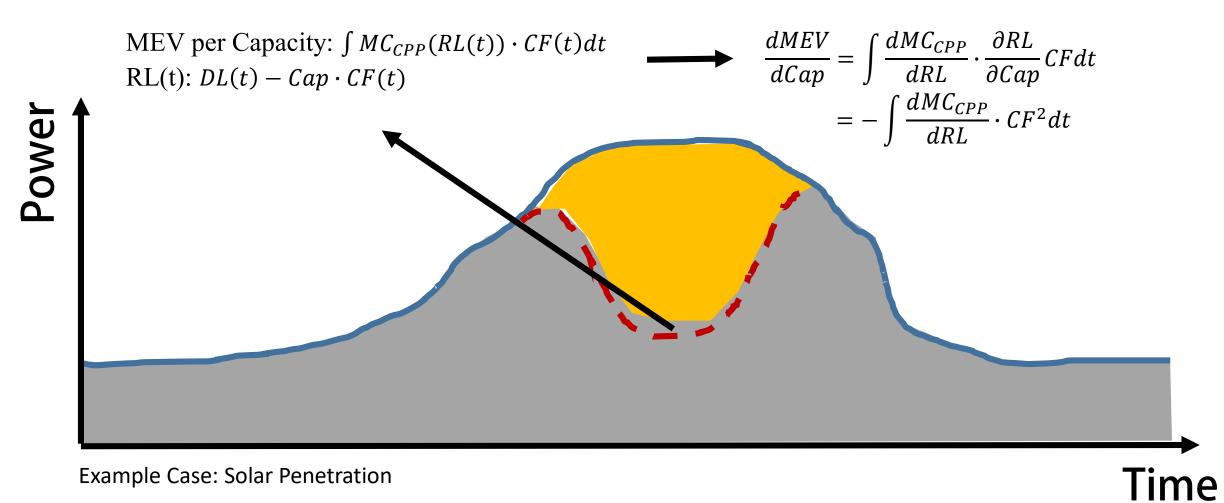

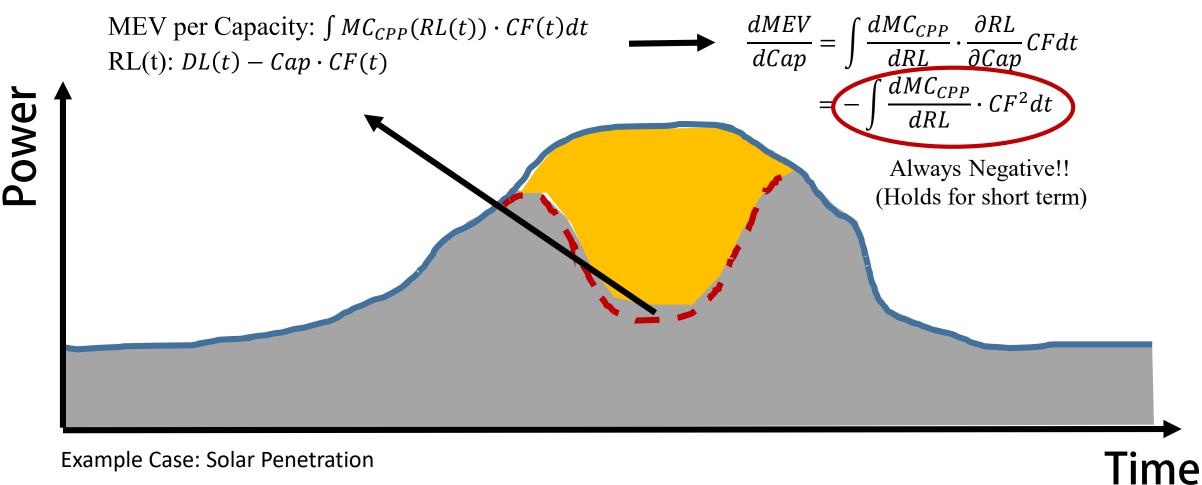


Example Case: Solar Penetration

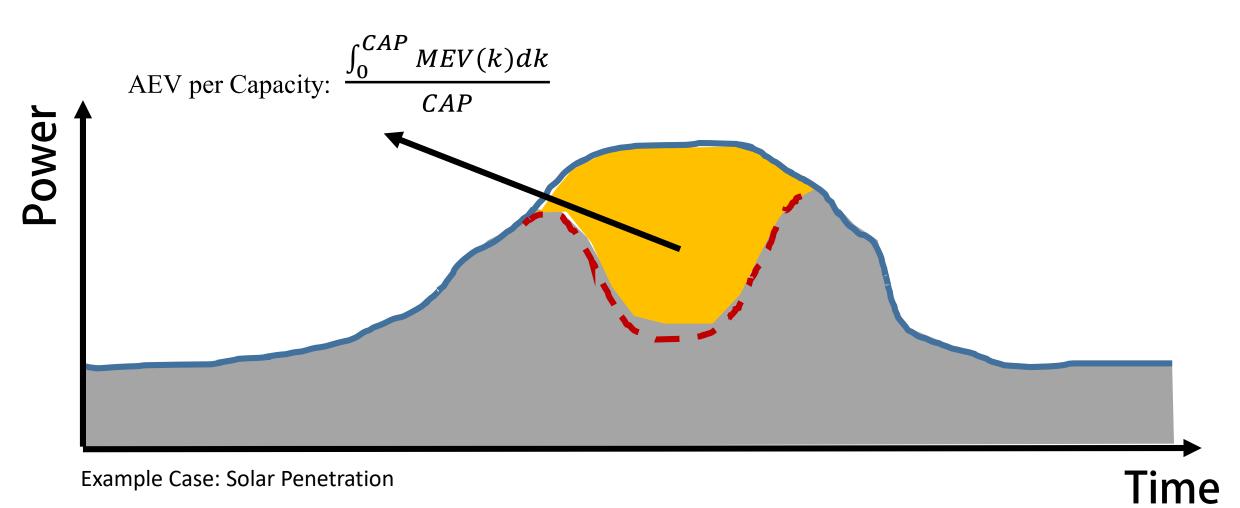

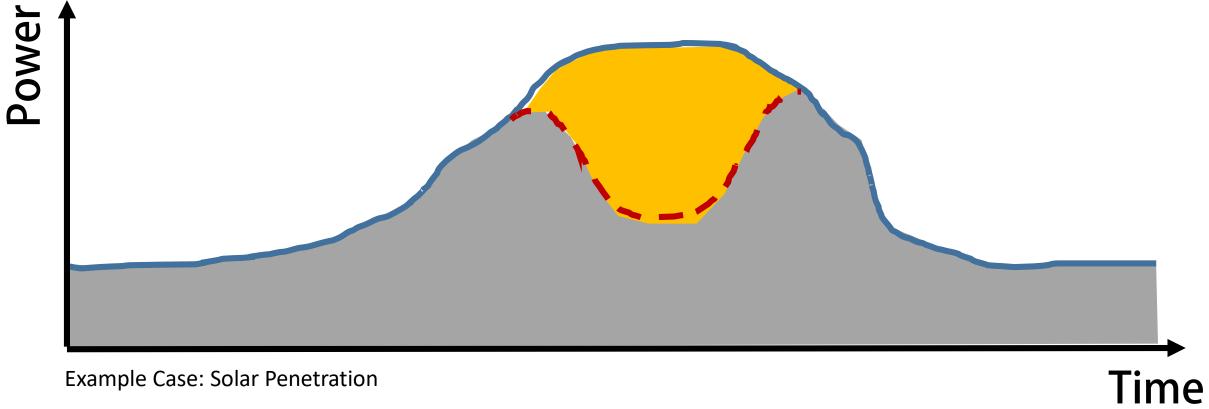

Example Case: Solar Penetration

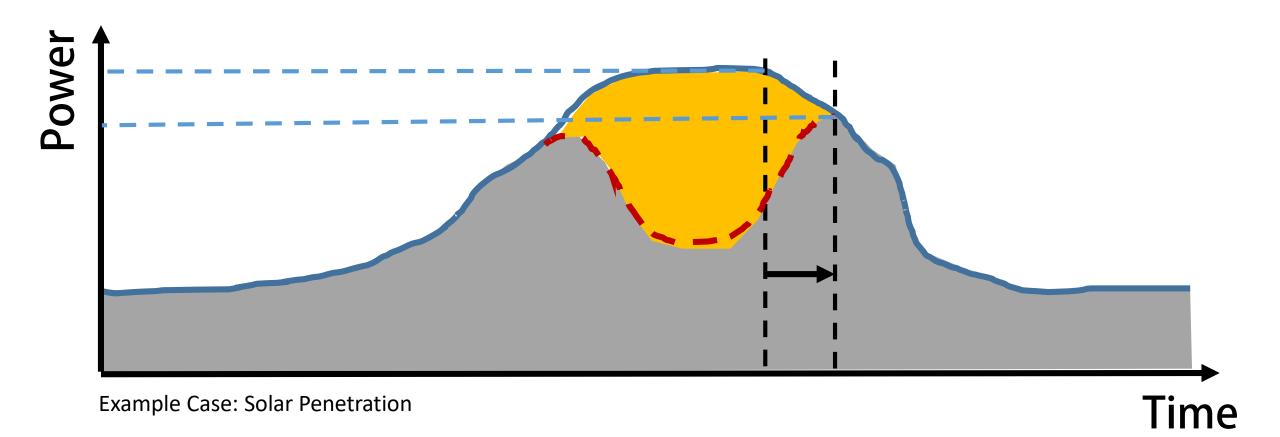

$$\gg \text{At peak RL,} \begin{cases} \left. \frac{\partial RL}{\partial t} \right|_{t^*(Cap)} = \left. \frac{dDL}{dt} \right|_{t^*(Cap)} - Cap \cdot \left. \frac{dCF}{dt} \right|_{t^*(Cap)} = 0 \\ \left. \frac{\partial^2 RL}{\partial t^2} \right|_{t^*(Cap)} = \left. \frac{d^2 DL}{dt^2} \right|_{t^*(Cap)} - Cap \cdot \left. \frac{d^2 CF}{dt^2} \right|_{t^*(Cap)} < 0 \end{cases}$$

 $\Rightarrow \text{After an infinitesimal increment of capacity, } \frac{\partial RL}{\partial t} \text{ at peak RL is still 0,}$ so $\frac{dt^*}{dCap} = -\frac{\frac{\partial^2 RL}{\partial t\partial Cap}\Big|_{t^*(Cap)}}{\frac{\partial^2 RL}{\partial t^2}\Big|_{t^*(Cap)}} = \frac{\frac{dCF}{dt}\Big|_{t^*(Cap)}}{\frac{d^2 DL}{dt^2}\Big|_{t^*(Cap)} - Cap \cdot \frac{d^2 CF}{dt^2}\Big|_{t^*(Cap)}}$

$$\succ \text{Meanwhile} \, \frac{dCF(t^*)}{dCap} = \left. \frac{dCF}{dt} \right|_{t^*(Cap)} \frac{dt^*}{dCap} = \left. \frac{\left(\frac{dCF}{dt} \right|_{t^*(Cap)} \right)^2}{\frac{d^2DL}{dt^2}} \right|_{t^*(Cap)} - Cap \cdot \frac{d^2CF}{dt^2} \right|_{t^*(Cap)}$$


➤Since CF(t*) is MCV, we can conclude that MCV always decreases as the capacity of VRE increases.


Discontinuous jumps of CF(t*) can occur, but the number of which can never exceed the amount of local maxima in the interval.

The ACV of solar in this case is
$$\frac{\int_{0}^{CAP} CF(t^{*}(k))dk}{CAP}$$

However, when two or more VRE technologies coexist in the power system, the contribution of each VRE technology to peak RL reduction will not be straight forward


Principle of Equipartition of Contribution: We should assume that at times when DL exceeds peak RL, every unit of VRE output contributes equally for the marginal RL reduction at that moment.

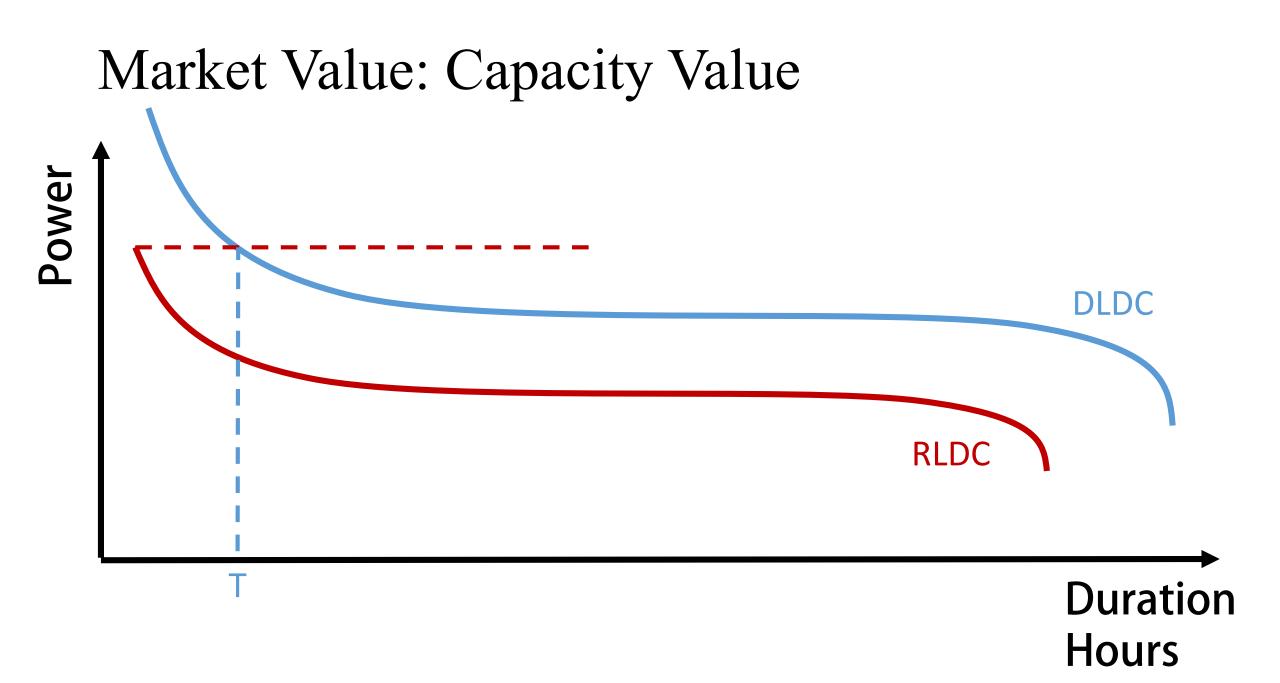

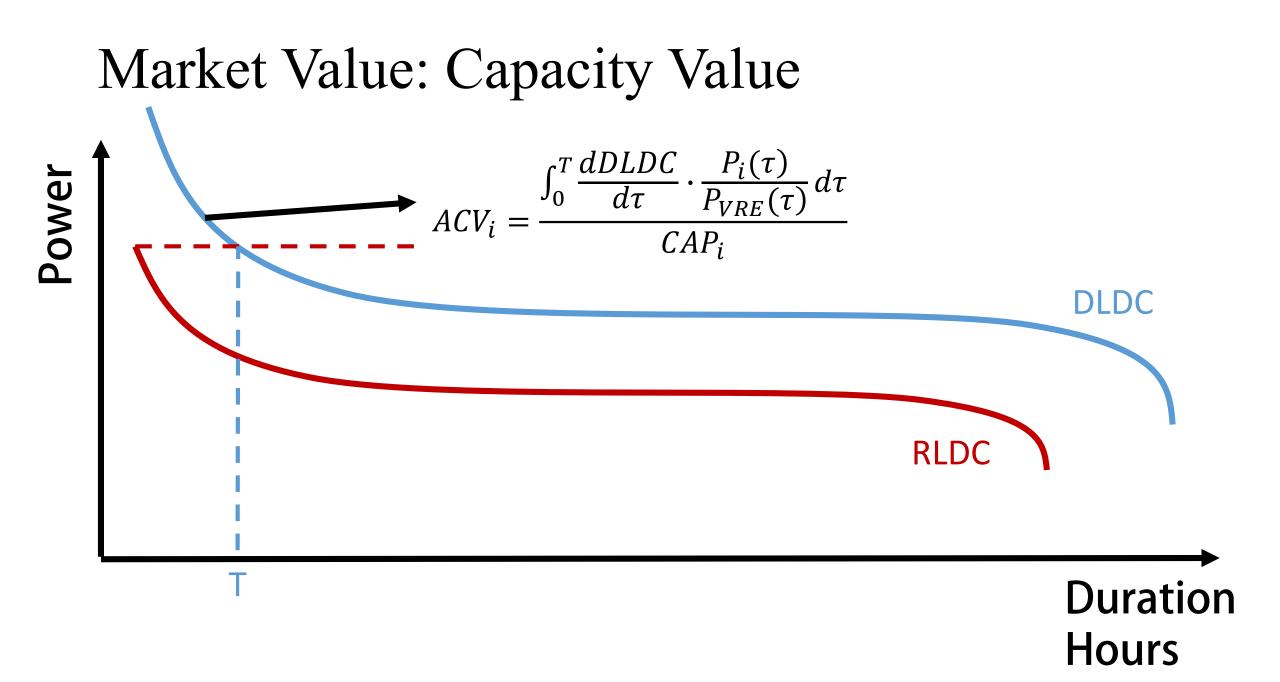

Power System in Taiwan

Real Data and Progonsis at High Summer

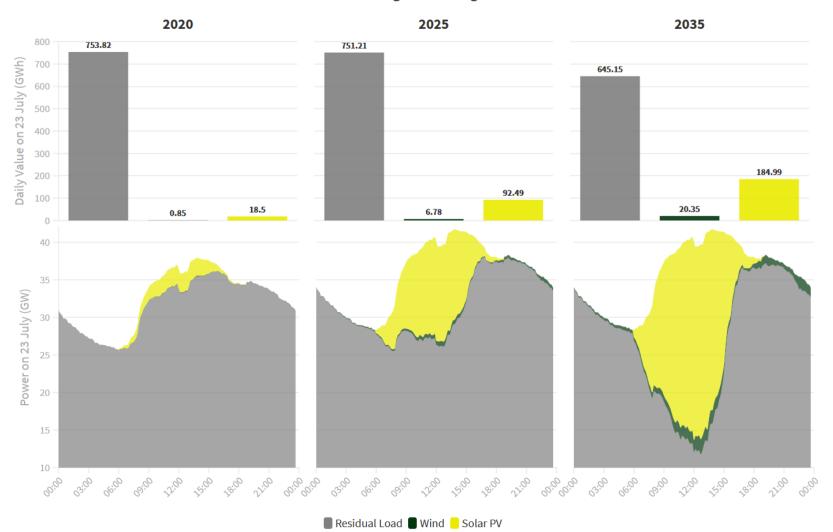


https://public.flourish.studio/visualisation/3351313/ https://public.flourish.studio/visualisation/3321437/

Capacity Values of VRE in Taiwan, Now and Future

	2020		2025		2035	
	Solar	Wind	Solar	Wind	Solar	Wind
Capacity	4,16 GW	0,831 GW	20,8 GW	6,65 GW	41,6 GW	19,9 GW
MCV	20,3%	3,73%	0%	5,66%	0%	3,49%
ACV	41,4%	10,3%	13,9%	6,54%	7,38%	4,22%
Total RL Reduction	1,81 GW		3,34 GW		3,91 GW	

Analysis with real data from 23 and 24 July, 2020

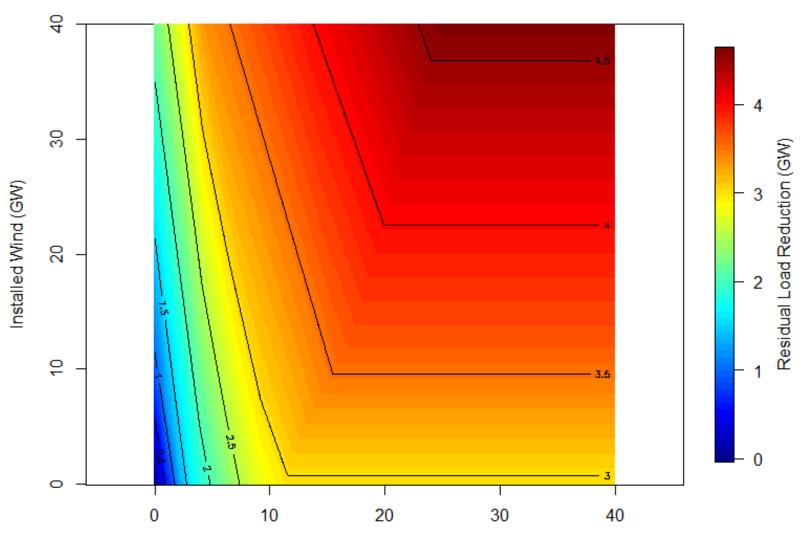

Installed Solar (GW)

Market Value: Short Term vs Long Term

- ➤In the short term equilibrium, CPP portfolio is assumed to be the same, thus MC_CPP does not change. The capacity value of VRE only consists the benefits of increased supply reliability due to less RL.
- ➤In the long term equilibrium, CPP portfolio will be altered due to principle of zero margin profit; CPP with less CAPEX but higher variable costs will be favored. This might result in higher MEV for VRE. On the other hand, the total CPP fleet will be reduced due to less peak RL, which can be translated to the capacity value of VRE under monetary terms.

➢ For every additional marginal reduction of RL by storage, the marginal capacity value of storage is the capacity of the storage.

➤ The marginal energy value will be the price spread between charge and discharge period. This value depends highly on the operation strategy of the storage.

➢In addition to the CAPEX per charge / discharge rate, two additional costs should be considered:

- ➤ The minimum required discharge time to achieve RL reduction. Construct two series {p_i} {n_j}, where i represents the i-th continuous interval for which RL > RL_c and j the j-th continuous interval for which RL < RL_c; p_i and n_j are the time durations of the continuous intervals. Starting from p_2 and the previous corresponding value in {n_j} (n_c), update p_2 <- max(p_1 n_c*eta, 0) + p_2, and continue this procedure for the rest of the series. Once all {p_i} updated, the maximum of the series will be the minimum required discharge time to achieve RL reduction to RL_c.</p>
- ➤ The energy loss due to charging cycle: an additional demand of (1/eta 1) per unit of discharge energy will be needed in total. This can be considered when calculating the MEV.

AA \bigvee

Cycle Period Requirement: About 1 Day

